



STATE OF TENNESSEE
DEPARTMENT OF ENVIRONMENT AND CONSERVATION
DIVISION OF WATER RESOURCES
William R. Snodgrass - Tennessee Tower
312 Rosa L. Parks Avenue, 11th Floor
Nashville, Tennessee 37243-1102

June 15, 2017

Honorable John Martin, Mayor
Town of Baxter
200 Main St.
Baxter, TN 38544
E-copy: jbm13131313@yahoo.com

Subject: **NPDES Permit No. TN0021121**
City of Baxter
Baxter, Putnam County, Tennessee

Dear Mayor Martin:

In accordance with the provisions of the Tennessee Water Quality Control Act, Tennessee Code Annotated (T.C.A.), Sections 69-3-101 through 69-3-120, the Division of Water Resources hereby issues the enclosed NPDES Permit. The continuance and/or reissuance of this NPDES Permit is contingent upon your meeting the conditions and requirements as stated therein.

Please be advised that a petition for permit appeal may be filed, pursuant to T.C.A. Section 69-3-105, subsection (i), by the permit applicant or by any aggrieved person who participated in the public comment period or gave testimony at a formal public hearing whose appeal is based upon any of the issues that were provided to the commissioner in writing during the public comment period or in testimony at a formal public hearing on the permit application. Additionally, for those permits for which the department gives public notice of a draft permit, any permit applicant or aggrieved person may base a permit appeal on any material change to conditions in the final permit from those in the draft, unless the material change has been subject to additional opportunity for public comment. Any petition for permit appeal under this subsection (i) shall be filed with the Technical Secretary of the Water Quality, Oil and Gas Board within thirty (30) days after public notice of the commissioner's decision to issue or deny the permit. A copy of the filing should also be sent to TDEC's Office of General Counsel.


If you have questions, please contact the Cookeville Environmental Field Office at 1-888-891-TDEC; or, at this office, please contact Mr. Jim McAdoo at (615) 532-0684 or by E-mail at Jim.McAdoo@tn.gov.

Sincerely,

Vojin Janjić
Manager, Water-Based Systems

Enclosure

cc: Cookeville Environmental Field Office

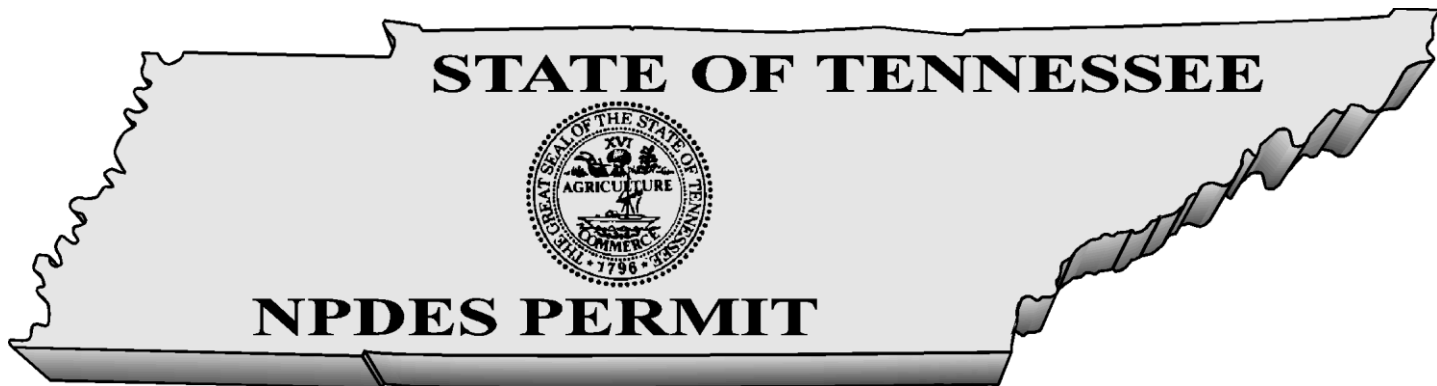

No. TN0021121

Authorization to discharge under the
National Pollutant Discharge Elimination System (NPDES)

Issued By

**STATE OF TENNESSEE
DEPARTMENT OF ENVIRONMENT AND CONSERVATION
DIVISION OF WATER RESOURCES
William R. Snodgrass - Tennessee Tower
312 Rosa L. Parks Avenue, 11th Floor
Nashville, Tennessee 37243-1102**

Under authority of the Tennessee Water Quality Control Act of 1977 (T.C.A. 69-3-101 et seq.) and the delegation of authority from the United States Environmental Protection Agency under the Federal Water Pollution Control Act, as amended by the Clean Water Act of 1977 (33 U.S.C. 1251, et seq.)

Discharger: **Baxter STP**

Is authorized to discharge: **treated domestic wastewater from Outfall 001**

From a facility located: **810 Elmore Town Road in Baxter, Putnam County, Tennessee
Latitude: 36.145122, Longitude: -85.645259**

To receiving waters named: **Mine Lick Creek at mile 15**

in accordance with effluent limitations, monitoring requirements and other conditions set forth herein.

This permit shall become effective on: **August 1, 2017**

This permit shall expire on: **June 30, 2022**

Issuance date: **July 1, 2017**

A handwritten signature in blue ink, appearing to read "Tisha Calabrese Benton".

For Tisha Calabrese Benton
Director

TABLE OF CONTENTS

	<u>Page</u>
1.0. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS	1
1.1. NUMERIC AND NARRATIVE EFFLUENT LIMITATIONS.....	1
1.2. MONITORING PROCEDURES.....	4
1.2.1. Representative Sampling	4
1.2.2. Sampling Frequency	5
1.2.3. Test Procedures	5
1.2.4. Recording of Results	6
1.2.5. Records Retention.....	6
1.3. REPORTING.....	6
1.3.1. Monitoring Results	6
1.3.2. Additional Monitoring by Permittee	7
1.3.3. Falsifying Results and/or Reports	7
1.3.4. Monthly Report of Operation	7
1.3.5. Bypass and Overflow Reporting	8
1.3.5.1. Report Requirements.....	8
1.3.5.2. Anticipated Bypass Notification	8
1.3.6. Reporting Less Than Detection; Reporting Significant Figures	8
1.4. COMPLIANCE WITH SECTION 208.....	8
1.5. REOPENER CLAUSE	9
1.6. SCHEDULE OF COMPLIANCE	9
2.0. GENERAL PERMIT REQUIREMENTS	10
2.1. GENERAL PROVISIONS.....	10
2.1.1. Duty to Reapply	10
2.1.2. Right of Entry.....	10
2.1.3. Availability of Reports.....	10
2.1.4. Proper Operation and Maintenance.....	10
2.1.5. Treatment Facility Failure (Industrial Sources).....	11
2.1.6. Property Rights.....	11
2.1.7. Severability	11
2.1.8. Other Information	11
2.2. CHANGES AFFECTING THE PERMIT	11
2.2.1. Planned Changes	11
2.2.2. Permit Modification, Revocation, or Termination	12
2.2.3. Change of Ownership	12
2.2.4. Change of Mailing Address.....	13
2.3. NONCOMPLIANCE	13
2.3.1. Effect of Noncompliance.....	13
2.3.2. Reporting of Noncompliance	13
2.3.3. Overflow	14
2.3.4. Upset	14
2.3.5. Adverse Impact.....	15
2.3.6. Bypass.....	15
2.3.7. Washout	16

2.4.	LIABILITIES	16
2.4.1.	<i>Civil and Criminal Liability</i>	16
2.4.2.	<i>Liability under State Law</i>	16
3.0.	PERMIT SPECIFIC REQUIREMENTS	17
3.1.	CERTIFIED OPERATOR.....	17
3.2.	POTW PRETREATMENT PROGRAM GENERAL PROVISIONS	17
3.3.	BIOSOLIDS MANAGEMENT PRACTICES.....	19
3.4.	PLACEMENT OF SIGNS	19
3.5.	ANTIDegradation	20
4.0.	DEFINITIONS AND ACRONYMS	21
4.1.	DEFINITIONS.....	21
4.2.	ACRONYMNS AND ABBREVIATIONS	24
RATIONALE	1	
1.	FACILITY INFORMATION	1
2.	RECEIVING STREAM INFORMATION	1
3.	CURRENT PERMIT STATUS	1
4.	NEW PERMIT LIMITATIONS AND COMPLIANCE SCHEDULE SUMMARY	2
5.	PREVIOUS PERMIT DISCHARGE MONITORING REPORT REVIEW	2
6.	PROPOSED EFFLUENT LIMITS AND RATIONALE	3
6.1.	<i>CBOD₅, Dissolved Oxygen, and Percent Removals Requirements</i>	3
6.2.	<i>NH₃-N toxicity</i>	4
6.3.	<i>Chlorination</i>	5
6.4.	<i>Total Nitrogen and Total Phosphorous monitoring/reporting</i>	5
6.5.	<i>E. coli Requirements</i>	5
6.6.	<i>Overflow and Bypass Reporting</i>	6
7.	OTHER PERMIT REQUIREMENTS AND CONDITIONS	6
7.1.	<i>Certified Wastewater Treatment Operator</i>	6
7.2.	<i>Collection System Certified Operator</i>	6
7.3.	<i>Pretreatment Program</i>	7
7.4.	<i>Permit Term</i>	7
7.6.	<i>ELECTRONIC REPORTING</i>	7
8.	ANTIDegradation STATEMENT/WATER QUALITY STATUS	7
APPENDIX 1	9	
APPENDIX 2	12	
DISCHARGE MONITORING REPORT SUMMARY	12	
APPENDIX 3	17	
MONITORING REDUCTION FREQUENCY	17	
APPENDIX 4	18	
EFFLUENT LIMITS AND MONITORING REQUIREMENTS	18	

1.0. EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

1.1. NUMERIC AND NARRATIVE EFFLUENT LIMITATIONS

The City of Baxter is authorized to discharge treated domestic wastewater from Outfall 001 to the Mine Lick Creek at mile 11. Discharge 001 consists of municipal wastewater from a treatment facility with a design capacity of .5 MGD. Discharge 001 shall be limited and monitored by the permittee as specified below:

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C	<=	20	mg/L	Composite	Once Per Week	Monthly Average
CBOD, 5-day, 20 C	<=	35	mg/L	Composite	Once Per Week	Daily Maximum
CBOD, 5-day, 20 C	<=	30	mg/L	Composite	Once Per Week	Weekly Average
CBOD, 5-day, 20 C	<=	125	lb/d	Composite	Once Per Week	Weekly Average
CBOD, 5-day, 20 C	<=	83	lb/d	Composite	Once Per Week	Monthly Average
Chlorine, total residual (TRC)	<=	0.02	mg/L	Grab	Five Per Week	Instantaneous Maximum
E. coli, MTEC-MF	<=	941	#/100mL	Grab	Three Per Week	Daily Maximum
E. coli, MTEC-MF	<=	126	#/100mL	Grab	Three Per Week	Monthly Geometric Mean
Flow	Report	-	MGD	Continuous	Daily	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Monthly Average
Nitrogen, Kjeldahl, Total (TKN as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	<=	15.3	lb/d	Calculated	Annual	Annual Average
Oxygen, dissolved (DO)	>=	6	mg/L	Grab	Five Per Week	Instantaneous Minimum
Phosphorus, total (as P)	Report	-	lb/d	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	<=	4.9	lb/d	Calculated	Annual	Annual Average
Settleable Solids	<=	1	mL/L	Composite	Once Per Week	Daily Maximum
Total Suspended Solids (TSS)	<=	167	lb/d	Composite	Once Per Week	Weekly Average
Total Suspended Solids (TSS)	<=	125	lb/d	Composite	Once Per Week	Monthly Average
Total Suspended Solids (TSS)	<=	30	mg/L	Composite	Once Per Week	Monthly Average
Total Suspended Solids (TSS)	<=	45	mg/L	Composite	Once Per Week	Daily Maximum
Total Suspended Solids (TSS)	<=	40	mg/L	Composite	Once Per Week	Weekly Average
pH	>=	6.0	SU	Grab	Five Per Week	Minimum

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Nitrogen, Ammonia total (as N)	<=	1.5	mg/L	Composite	Once Per Week	Weekly Average
Nitrogen, Ammonia total (as N)	<=	4	lb/d	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	2	mg/L	Composite	Once Per Week	Daily Maximum
Nitrogen, Ammonia total (as N)	<=	1	mg/L	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	6	lb/d	Composite	Once Per Week	Weekly Average

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Nitrogen, Ammonia total (as N)	<=	4	mg/L	Composite	Once Per Week	Daily Maximum
Nitrogen, Ammonia total (as N)	<=	2	mg/L	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	3	mg/L	Composite	Once Per Week	Weekly Average
Nitrogen, Ammonia total (as N)	<=	8	lb/d	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	13	lb/d	Composite	Once Per Week	Weekly Average

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C, % removal	>=	40	%	Calculated	Once Per Week	Minimum Percent Removal
CBOD, 5-day, 20 C, % removal	>=	85	%	Calculated	Once Per Week	Average (Minimum)
TSS, % removal	>=	85	%	Calculated	Once Per Week	Average (Minimum)
TSS, % removal	>=	40	%	Calculated	Once Per Week	Minimum Percent Removal

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C	Report	-	mg/L	Composite	Once Per Week	Monthly Average
CBOD, 5-day, 20 C	Report	-	mg/L	Composite	Once Per Week	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	Report	-	mg/L	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Total Suspended Solids (TSS)	Report	-	mg/L	Composite	Once Per Week	Monthly Average

Total Suspended Solids (TSS) Report - mg/L Composite Once Per Week Daily Maximum

Description : External Outfall, Number : 001, Monitoring : Wet Weather, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Bypass of Treatment	Report	-	occur/mo	Occurrences	Continuous	Monthly Total
Overflow use, occurrences	Report	-	occur/mo	Occurrences	Continuous	Monthly Total

Notes: The permittee shall achieve 85% removal of CBOD₅ and TSS on a monthly average basis. The permittee shall report all instances of overflow and/or bypasses. See Part 2.3.3.a for the definition of overflow and Part 1.3.5.1 for reporting requirements.

Unless elsewhere specified, summer months are May through October; winter months are November through April.

See Part 1.2.3 for test procedures.

See Part 3.4 for biomonitoring test and reporting requirements. See next page for percent removal calculations.

Total residual chlorine (TRC) monitoring shall be applicable when chlorine, bromine, or any other oxidants are added. The acceptable methods for analysis of TRC are any methods specified in Title 40 CFR, Part 136 as amended. The method detection level (MDL) for TRC shall not exceed 0.05 mg/l unless the permittee demonstrates that its MDL is higher. The permittee shall retain the documentation that justifies the higher MDL and have it available for review upon request. In cases where the permit limit is less than the MDL, the reporting of TRC at less than the MDL shall be interpreted to constitute compliance with the permit.

The wastewater discharge must be disinfected to the extent that viable coliform organisms are effectively eliminated. The concentration of the *E. coli* group after disinfection shall not exceed 126 cfu per 100 ml as the geometric mean calculated on the actual number of samples collected and tested for *E. coli* within the required reporting period. The permittee may collect more samples than specified as the monitoring frequency. Samples may not be collected at intervals of less than 12 hours. For the purpose of determining the geometric mean, individual samples having an *E. coli* group concentration of less than one (1) per 100 ml shall be considered as having a concentration of one (1) per 100 ml. In addition, the concentration of the *E. coli* group in any individual sample shall not exceed a specified maximum amount. A maximum daily limit of 487 colonies per 100 ml applies to lakes and exceptional Tennessee waters. A maximum daily limit of 941 colonies per 100 ml applies to all other recreational waters.

There shall be no distinctly visible floating scum, oil or other matter contained in the wastewater discharge. The wastewater discharge must not cause an objectionable color contrast in the receiving stream.

The wastewater discharge shall not contain pollutants in quantities that will be hazardous or otherwise detrimental to humans, livestock, wildlife, plant life, or fish and aquatic life in the receiving stream.

Sludge or any other material removed by any treatment works must be disposed of in a manner that prevents its entrance into or pollution of any surface or subsurface waters. Additionally, the disposal of such sludge or other material must be in compliance with the Tennessee Solid Waste Disposal Act, TCA 68-31-101 et seq. and the Tennessee Hazardous Waste Management Act, TCA 68-46-101 et seq.

Nothing in this permit authorizes take for the purposes of a facility's compliance with the Endangered Species Act. (40 C.F.R. 125.98(b)(1))

For the purpose of evaluating compliance with the permit limits established herein, where certain limits are below the State of Tennessee published required detection levels (RDLs) for any given effluent characteristics, the results of analyses below the RDL shall be reported as Below Detection Level (BDL), unless in specific cases other detection limits are demonstrated to be the best achievable because of the particular nature of the wastewater being analyzed.

For CBOD₅ and TSS, the treatment facility shall demonstrate a minimum of 85% removal efficiency on a monthly average basis. This is calculated by determining an average of all daily influent concentrations and comparing this to an average of all daily effluent concentrations. The formula for this calculation is as follows:

$$\left[1 - \frac{\text{average of daily effluent concentration}}{\text{average of daily influent concentration}} \right] \times 100\% = \% \text{ removal}$$

The treatment facility will also demonstrate 40% minimum removal of the CBOD₅ and TSS based upon each daily composite sample. The formula for this calculation is as follows:

$$\left[1 - \frac{\text{daily effluent concentration}}{\text{daily influent concentration}} \right] \times 100\% = \% \text{ removal}$$

1.2. MONITORING PROCEDURES

1.2.1. Representative Sampling

Samples and measurements taken in compliance with the monitoring requirements specified herein shall be representative of the volume and nature of the monitored discharge, and shall be taken after treatment and prior to mixing with uncontaminated storm water runoff or the receiving stream. Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to insure the accuracy and reliability of measurements of the volume of monitored discharges. The

devices shall be installed, calibrated and maintained to insure that the accuracy of the measurements is consistent with accepted capability of that type of device. Devices selected shall be capable of measuring flows with a maximum deviation of less than plus or minus 10% from the true discharge rates throughout the range of expected discharge volumes.

Samples and measurements taken in compliance with the monitoring requirements specified above shall be representative of the volume and nature of the monitored discharge, and shall be taken at the following location(s):

Influent samples must be collected prior to mixing with any other wastewater being returned to the head of the plant, such as sludge return. Those systems with more than one influent line must collect samples from each and proportion the results by the flow from each line.

Effluent samples must be representative of the wastewater being discharged and collected prior to mixing with any other discharge or the receiving stream. This can be a different point for different parameters, but must be after all treatment for that parameter or all expected change:

- a. The chlorine residual must be measured after the chlorine contact chamber and any dechlorination. It may be to the advantage of the permittee to measure at the end of any long outfall lines.
- b. Samples for *E. coli* can be collected at any point between disinfection and the actual discharge.
- c. The dissolved oxygen can drop in the outfall line; therefore, D.O. measurements are required at the discharge end of outfall lines greater than one mile long. Systems with outfall lines less than one mile may measure dissolved oxygen as the wastewater leaves the treatment facility. For systems with dechlorination, dissolved oxygen must be measured after this step and as close to the end of the outfall line as possible.
- d. Total suspended solids and settleable solids can be collected at any point after the final clarifier.
- e. Biomonitoring tests (if required) shall be conducted on final effluent.

1.2.2. Sampling Frequency

Where the permit requires sampling and monitoring of a particular effluent characteristic(s) at a frequency of less than once per day or daily, the permittee is precluded from marking the "No Discharge" block on the Discharge Monitoring Report if there has been any discharge from that particular outfall during the period which coincides with the required monitoring frequency; i.e. if the required monitoring frequency is once per month or 1/month, the monitoring period is one month, and if the discharge occurs during only one day in that period then the permittee must sample on that day and report the results of analyses accordingly.

1.2.3. Test Procedures

- a. Test procedures for the analysis of pollutants shall conform to regulations published pursuant to Section 304 (h) of the Clean Water Act (the "Act"), as amended, under which such procedures may be required.
- b. Unless otherwise noted in the permit, all pollutant parameters shall be determined according to methods prescribed in Title 40, CFR, Part 136, as amended, promulgated pursuant to Section 304 (h) of the Act.
- c. Composite samples must be proportioned by flow at time of sampling. Aliquots may be collected manually or automatically. The sample aliquots must be maintained at ≤ 6 degrees Celsius during the compositing period.
- d. In instances where permit limits established through implementation of applicable water criteria are below analytical capabilities, compliance with those limits will be determined using the detection limits described in the TN Rules, Chapter 0400-40-03-.05(8).

1.2.4. Recording of Results

For each measurement or sample taken pursuant to the requirements of this permit, the permittee shall record the following information:

- a. The exact place, date and time of sampling;
- b. The exact person(s) collecting samples;
- c. The dates and times the analyses were performed;
- d. The person(s) or laboratory who performed the analyses;
- e. The analytical techniques or methods used, and;
- f. The results of all required analyses.

1.2.5. Records Retention

All records and information resulting from the monitoring activities required by this permit including all records of analyses performed and calibration and maintenance of instrumentation shall be retained for a minimum of three (3) years, or longer, if requested by the Division of Water Resources.

1.3. REPORTING

1.3.1. Monitoring Results

Monitoring results shall be recorded monthly and submitted monthly using NETDMR. Submittals shall be no later than 15 days after the completion of the reporting period. If NETDMR is not functioning, a completed DMR with an original signature shall be submitted to the following address:

**STATE OF TENNESSEE
DEPARTMENT OF ENVIRONMENT AND CONSERVATION
DIVISION OF WATER RESOURCES
COMPLIANCE & ENFORCEMENT SECTION
William R. Snodgrass - Tennessee Tower
312 Rosa L. Parks Avenue, 11th Floor
Nashville, Tennessee 37243-1102**

If NETDMR is not functioning, a copy of the completed and signed DMR shall be mailed to the Cookeville Environmental Field Office (EFO) at the following address:

**STATE OF TENNESSEE
DEPARTMENT OF ENVIRONMENT AND CONSERVATION
DIVISION OF WATER RESOURCES
Cookeville Environmental Field Office
1221 South Willow Avenue
Cookeville, Tennessee 38506**

A copy should be retained for the permittee's files. In addition, any communication regarding compliance with the conditions of this permit must be sent to the two offices listed above.

The first DMR is due on the 15th of the month following permit effectiveness.

DMRs and any other information or report must be signed and certified by a responsible corporate officer as defined in 40 CFR 122.22, a general partner or proprietor, or a principal municipal executive officer or ranking elected official, or his duly authorized representative. Such authorization must be submitted in writing and must explain the duties and responsibilities of the authorized representative.

The electronic submission of DMR data will be accepted only if formally approved beforehand by the division. For purposes of determining compliance with this permit, data approved by the division to be submitted electronically is legally equivalent to data submitted on signed and certified DMR forms.

1.3.2. Additional Monitoring by Permittee

If the permittee monitors any pollutant specifically limited by this permit more frequently than required at the location(s) designated, using approved analytical methods as specified herein, the results of such monitoring shall be included in the calculation and reporting of the values required in the DMR form. Such increased frequency shall also be indicated on the form.

1.3.3. Falsifying Results and/or Reports

Knowingly making any false statement on any report required by this permit or falsifying any result may result in the imposition of criminal penalties as provided for in Section 309 of the Federal Water Pollution Control Act, as amended, and in Section 69-3-115 of the Tennessee Water Quality Control Act.

1.3.4. Monthly Report of Operation

Monthly operational reports shall be submitted on standard forms to the appropriate Division of Water Resources Environmental Field Office in Jackson, Nashville, Chattanooga, Columbia, Cookeville, Memphis, Johnson City, or Knoxville. Reports shall be submitted by the 15th day of the month following data collection.

1.3.5. Bypass and Overflow Reporting

1.3.5.1. Report Requirements

A summary report of known or suspected instances of overflows in the collection system or bypass of wastewater treatment facilities shall accompany the Discharge Monitoring Report. The report must contain the date and duration of the instances of overflow and/or bypassing and the estimated quantity of wastewater released and/or bypassed.

The report must also detail activities undertaken during the reporting period to (1) determine if overflow is occurring in the collection system, (2) correct those known or suspected overflow points and (3) prevent future or possible overflows and any resulting bypassing at the treatment facility.

On the DMR, the permittee must report the number of sanitary sewer overflows, dry-weather overflows and in-plant bypasses separately. Three lines must be used on the DMR form, one for sanitary sewer overflows, one for dry-weather overflows and one for in-plant bypasses.

1.3.5.2. Anticipated Bypass Notification

If, because of unavoidable maintenance or construction, the permittee has need to create an in-plant bypass which would cause an effluent violation, the permittee must notify the division as soon as possible, but in any case, no later than 10 days prior to the date of the bypass.

1.3.6. Reporting Less Than Detection; Reporting Significant Figures

A permit limit may be less than the accepted detection level. If the samples are below the detection level, then report "BDL" or "NODI =B" on the DMRs. The permittee must use the correct detection levels in all analytical testing required in the permit. The required detection levels are listed in the Rules of the Department of Environment and Conservation, Division of Water Resources, Chapter 0400-40-03-.05(8).

For example, if the limit is 0.02 mg/l with a detection level of 0.05 mg/l and detection is shown; 0.05 mg/l must be reported. In contrast, if nothing is detected reporting "BDL" or "NODI =B" is acceptable.

Reported results are to correspond to the number of significant figures (decimal places) set forth in the permit conditions. The permittee shall round values, if allowed by the method of sample analysis, using a uniform rounding convention adopted by the permittee.

1.4. COMPLIANCE WITH SECTION 208

The limits and conditions in this permit shall require compliance with an area-wide waste treatment plan (208 Water Quality Management Plan) where such approved plan is applicable.

1.5. REOPENER CLAUSE

This permit shall be modified, or alternatively revoked and reissued, to comply with any applicable effluent standard or limitation issued or approved under Sections 301(b)(2)(C) and (D), 307(a)(2) and 405(d)(2)(D) of the Clean Water Act, as amended, if the effluent standard, limitation or sludge disposal requirement so issued or approved:

- a. Contains different conditions or is otherwise more stringent than any condition in the permit; or
- b. Controls any pollutant or disposal method not addressed in the permit.

The permit as modified or reissued under this paragraph shall also contain any other requirements of the Act then applicable.

1.6. SCHEDULE OF COMPLIANCE

Full compliance and operational levels shall be attained from the effective date of this permit.

2.0. GENERAL PERMIT REQUIREMENTS

2.1. GENERAL PROVISIONS

2.1.1. Duty to Reapply

Permittee is not authorized to discharge after the expiration date of this permit. In order to receive authorization to discharge beyond the expiration date, the permittee shall submit such information and forms as are required to the Director of the Division of Water Resources (the "director") no later than 180 days prior to the expiration date. Such forms shall be properly signed and certified.

2.1.2. Right of Entry

The permittee shall allow the director, the Regional Administrator of the U.S. Environmental Protection Agency, or their authorized representatives, upon the presentation of credentials:

- a. To enter upon the permittee's premises where an effluent source is located or where records are required to be kept under the terms and conditions of this permit, and at reasonable times to copy these records;
- b. To inspect at reasonable times any monitoring equipment or method or any collection, treatment, pollution management, or discharge facilities required under this permit; and
- c. To sample at reasonable times any discharge of pollutants.

2.1.3. Availability of Reports

Except for data determined to be confidential under Section 308 of the Federal Water Pollution Control Act, as amended, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Division of Water Resources. As required by the Federal Act, effluent data shall not be considered confidential.

2.1.4. Proper Operation and Maintenance

- a. The permittee shall at all times properly operate and maintain all facilities and systems (and related appurtenances) for collection and treatment which are installed or used by the permittee to achieve compliance with the terms and conditions of this permit. Proper operation and maintenance also includes adequate laboratory and process controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems, which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit. Backup continuous pH and flow monitoring equipment are not required.

- b. Dilution water shall not be added to comply with effluent requirements to achieve BCT, BPT, BAT and or other technology based effluent limitations such as those in State of Tennessee Rule 0400-40-05-.09.

2.1.5. Treatment Facility Failure (Industrial Sources)

The permittee, in order to maintain compliance with this permit, shall control production, all discharges, or both, upon reduction, loss, or failure of the treatment facility, until the facility is restored or an alternative method of treatment is provided. This requirement applies in such situations as the reduction, loss, or failure of the primary source of power.

2.1.6. Property Rights

The issuance of this permit does not convey any property rights in either real or personal property, or any exclusive privileges, nor does it authorize any injury to private property or any invasion of personal rights, nor any infringement of federal, state, or local laws or regulations.

2.1.7. Severability

The provisions of this permit are severable. If any provision of this permit due to any circumstance, is held invalid, then the application of such provision to other circumstances and to the remainder of this permit shall not be affected thereby.

2.1.8. Other Information

If the permittee becomes aware of failure to submit any relevant facts in a permit application, or of submission of incorrect information in a permit application or in any report to the director, then the permittee shall promptly submit such facts or information.

2.2. CHANGES AFFECTING THE PERMIT

2.2.1. Planned Changes

The permittee shall give notice to the director as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required only when:

- a. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
- b. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants, which are subject neither to effluent limitations in the permit, nor to notification requirements under 40 CFR 122.42(a)(1).

2.2.2. Permit Modification, Revocation, or Termination

- a. This permit may be modified, revoked and reissued, or terminated for cause as described in 40 CFR 122.62 and 122.64, Federal Register, Volume 49, No. 188 (Wednesday, September 26, 1984), as amended.
- b. The permittee shall furnish to the director, within a reasonable time, any information which the director may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with this permit. The permittee shall also furnish to the director, upon request, copies of records required to be kept by this permit.
- c. If any applicable effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is established for any toxic pollutant under Section 307(a) of the Federal Water Pollution Control Act, as amended, the director shall modify or revoke and reissue the permit to conform to the prohibition or to the effluent standard, providing that the effluent standard is more stringent than the limitation in the permit on the toxic pollutant. The permittee shall comply with these effluent standards or prohibitions within the time provided in the regulations that establish these standards or prohibitions, even if the permit has not yet been modified or revoked and reissued to incorporate the requirement.
- d. The filing of a request by the permittee for a modification, revocation, reissuance, termination, or notification of planned changes or anticipated noncompliance does not halt any permit condition.

2.2.3. Change of Ownership

This permit may be transferred to another party (provided there are neither modifications to the facility or its operations, nor any other changes which might affect the permit limits and conditions contained in the permit) by the permittee if:

- a. The permittee notifies the director of the proposed transfer at least 30 days in advance of the proposed transfer date;
- b. The notice includes a written agreement between the existing and new permittees containing a specified date for transfer of permit responsibility, coverage, and liability between them; and
- c. The director, within 30 days, does not notify the current permittee and the new permittee of his intent to modify, revoke or reissue, or terminate the permit and to require that a new application be filed rather than agreeing to the transfer of the permit.

Pursuant to the requirements of 40 CFR 122.61, concerning transfer of ownership, the permittee must provide the following information to the division in their formal notice of intent to transfer ownership: 1) the NPDES permit number of the subject permit; 2) the effective date of the proposed transfer; 3) the name and address of the transferor; 4) the name and address of the transferee; 5) the names of the responsible parties for both the transferor and transferee; 6) a statement that the transferee assumes responsibility for the subject NPDES permit; 7) a statement that the transferor relinquishes responsibility for the

subject NPDES permit; 8) the signatures of the responsible parties for both the transferor and transferee pursuant to the requirements of 40 CFR 122.22(a), "Signatories to permit applications"; and, 9) a statement regarding any proposed modifications to the facility, its operations, or any other changes which might affect the permit limits and conditions contained in the permit.

2.2.4. Change of Mailing Address

The permittee shall promptly provide to the director written notice of any change of mailing address. In the absence of such notice the original address of the permittee will be assumed to be correct.

2.3. NONCOMPLIANCE

2.3.1. Effect of Noncompliance

All discharges shall be consistent with the terms and conditions of this permit. Any permit noncompliance constitutes a violation of applicable state and federal laws and is grounds for enforcement action, permit termination, permit modification, or denial of permit reissuance.

2.3.2. Reporting of Noncompliance

a. 24-Hour Reporting

In the case of any noncompliance which could cause a threat to public drinking supplies, or any other discharge which could constitute a threat to human health or the environment, the required notice of non-compliance shall be provided to the Division of Water Resources in the appropriate Environmental Field Office within 24-hours from the time the permittee becomes aware of the circumstances. (The Environmental Field Office should be contacted for names and phone numbers of environmental response team).

A written submission must be provided within five days of the time the permittee becomes aware of the circumstances unless the director on a case-by-case basis waives this requirement. The permittee shall provide the director with the following information:

- i. A description of the discharge and cause of noncompliance;
- ii. The period of noncompliance, including exact dates and times or, if not corrected, the anticipated time the noncompliance is expected to continue; and
- iii. The steps being taken to reduce, eliminate, and prevent recurrence of the noncomplying discharge.

b. Scheduled Reporting

For instances of noncompliance which are not reported under subparagraph 2.3.2.a above, the permittee shall report the noncompliance on the Discharge Monitoring Report. The report shall contain all information concerning the steps taken, or planned, to reduce, eliminate, and prevent recurrence of the violation and the anticipated time the violation is expected to continue.

2.3.3. **Overflow**

- a. "**Overflow**" means any release of sewage from any portion of the collection, transmission, or treatment system other than through permitted outfalls.
- b. Overflows are prohibited.
- c. The permittee shall operate the collection system so as to avoid overflows.
- d. No new or additional flows shall be added upstream of any point in the collection system, which experiences chronic overflows (greater than 5 events per year) or would otherwise overload any portion of the system. Unless there is specific enforcement action to the contrary, the permittee is relieved of this requirement after: 1) an authorized representative of the Commissioner of the Department of Environment and Conservation has approved an engineering report and construction plans and specifications prepared in accordance with accepted engineering practices for correction of the problem; 2) the correction work is underway; and 3) the cumulative, peak-design, flows potentially added from new connections and line extensions upstream of any chronic overflow point are less than or proportional to the amount of inflow and infiltration removal documented upstream of that point. The inflow and infiltration reduction must be measured by the permittee using practices that are customary in the environmental engineering field and reported in an attachment to a Monthly Operating Report submitted to the local TDEC Environmental Field Office. The data measurement period shall be sufficient to account for seasonal rainfall patterns and seasonal groundwater table elevations.
- e. In the event that more than 5 overflows have occurred from a single point in the collection system for reasons that may not warrant the self-imposed moratorium or completion of the actions identified in this paragraph, the permittee may request a meeting with the Division of Water Resources EFO staff to petition for a waiver based on mitigating evidence.

2.3.4. **Upset**

- a. "**Upset**" means an exceptional incident in which there is unintentional and temporary noncompliance with technology-based effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.
- b. An upset shall constitute an affirmative defense to an action brought for noncompliance with such technology-based permit effluent limitations if the permittee demonstrates, through properly signed, contemporaneous operating logs, or other relevant evidence that:

- i. An upset occurred and that the permittee can identify the cause(s) of the upset;
- ii. The permitted facility was at the time being operated in a prudent and workman-like manner and in compliance with proper operation and maintenance procedures;
- iii. The permittee submitted information required under "Reporting of Noncompliance" within 24-hours of becoming aware of the upset (if this information is provided orally, a written submission must be provided within five days); and
- iv. The permittee complied with any remedial measures required under "Adverse Impact."

2.3.5. Adverse Impact

The permittee shall take all reasonable steps to minimize any adverse impact to the waters of Tennessee resulting from noncompliance with this permit, including such accelerated or additional monitoring as necessary to determine the nature and impact of the noncomplying discharge. It shall not be a defense for the permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

2.3.6. Bypass

- a. "**Bypass**" is the intentional diversion of waste streams from any portion of a treatment facility. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities which would cause them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.
- b. Bypasses are prohibited unless all of the following 3 conditions are met:
 - i. The bypass is unavoidable to prevent loss of life, personal injury, or severe property damage;
 - ii. There are no feasible alternatives to bypass, such as the construction and use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass, which occurred during normal periods of equipment downtime or preventative maintenance;
 - iii. The permittee submits notice of an unanticipated bypass to the Division of Water Resources in the appropriate Environmental Field Office within 24 hours of becoming aware of the bypass (if this information is provided orally, a written submission must be provided within five days). When the need for the bypass is foreseeable, prior notification shall be submitted to the director, if possible, at least 10 days before the date of the bypass.
- c. Bypasses not exceeding permit limitations are allowed **only** if the bypass is necessary for essential maintenance to assure efficient operation. All other bypasses are

prohibited. Allowable bypasses not exceeding limitations are not subject to the reporting requirements of 2.3.6.b.iii, above.

2.3.7. Washout

- a. For domestic wastewater plants only, a "washout" shall be defined as loss of Mixed Liquor Suspended Solids (MLSS) of 30.00% or more. This refers to the MLSS in the aeration basin(s) only. This does not include MLSS decrease due to solids wasting to the sludge disposal system. A washout can be caused by improper operation or from peak flows due to infiltration and inflow.
- b. A washout is prohibited. If a washout occurs the permittee must report the incident to the Division of Water Resources in the appropriate Environmental Field Office within 24 hours by telephone. A written submission must be provided within five days. The washout must be noted on the discharge monitoring report. Each day of a washout is a separate violation.

2.4. LIABILITIES

2.4.1. Civil and Criminal Liability

Except as provided in permit conditions for "***Bypassing***," "***Overflow***," and "***Upset***," nothing in this permit shall be construed to relieve the permittee from civil or criminal penalties for noncompliance. Notwithstanding this permit, the permittee shall remain liable for any damages sustained by the State of Tennessee, including but not limited to fish kills and losses of aquatic life and/or wildlife, as a result of the discharge of wastewater to any surface or subsurface waters. Additionally, notwithstanding this Permit, it shall be the responsibility of the permittee to conduct its wastewater treatment and/or discharge activities in a manner such that public or private nuisances or health hazards will not be created.

2.4.2. Liability under State Law

Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to any applicable state law or the Federal Water Pollution Control Act, as amended.

3.0. PERMIT SPECIFIC REQUIREMENTS

3.1. CERTIFIED OPERATOR

The waste treatment facilities shall be operated under the supervision of a certified wastewater treatment operator and the collection system shall be operated under the supervision of a certified collection system operator in accordance with the Water Environmental Health Act of 1984.

3.2. POTW PRETREATMENT PROGRAM GENERAL PROVISIONS

As an update of information previously submitted to the division, the permittee will undertake the following activity.

- a. The permittee shall submit the results of an Industrial Waste Survey (IWS) in accordance with 40 CFR 403.8(f)(2)(i), including any industrial users (IU) covered under Section 301(i)(2) of the Act. As much information as possible must be obtained relative to the character and volume of pollutants contributed to the POTW by the IUs. This information will be submitted to the Division of Water Resources, Pretreatment Section within one hundred twenty (120) days of the effective date of this permit, unless such a survey has been submitted within 3 years of the effective date. Development of a pretreatment program may be required after completion of the industrial user review. All requirements and conditions of the pretreatment program are enforceable through the NPDES permit.
- b. The permittee shall enforce 40 CFR 403.5, "prohibited discharges". Pollutants introduced into the POTW by a non-domestic source shall not cause pass through or interference as defined in 40 CFR Part 403.3. These general prohibitions and the specific prohibitions in this section apply to all non-domestic sources introducing pollutants into the POTW whether the source is subject to other National Pretreatment Standards or any state or local pretreatment requirements.

Specific prohibitions. Under no circumstances shall the permittee allow introduction of the following wastes in the waste treatment system:

- i. Pollutants which create a fire or explosion hazard in the POTW;
- ii. Pollutants which will cause corrosive structural damage to the treatment works, but in no case discharges with pH less than 5.0 unless the system is specifically designed to accept such discharges.
- iii. Solid or viscous pollutants in amounts which will cause obstruction to the flow in the treatment system resulting in interference.

- iv. Any pollutant, including oxygen-demanding pollutants (BOD, etc.) released in a discharge at a flow rate and/or pollutant concentration which will cause interference with the treatment works.
 - v. Heat in amounts which will inhibit biological activity in the treatment works resulting in interference, but in no case heat in such quantities that the temperature at the treatment works exceeds 40°C (104°F) unless the works are designed to accommodate such heat.
 - vi. Any priority pollutant in amounts that will contaminate the treatment works sludge.
 - vii. Petroleum oil, nonbiodegradable cutting oil, or products of mineral oil origin in amounts that will cause interference or pass through;
 - viii. Pollutants which result in the presence of toxic gases, vapors or fumes within the POTW in a quantity that may cause acute worker health and safety problems;
 - ix. Any trucked or hauled pollutants except at discharge points designated by the POTW.
- c. The permittee shall notify the Tennessee Division of Water Resources of any of the following changes in user discharge to the system no later than 30 days prior to change of discharge:
- i. New introductions into such works of pollutants from any source which would be a new source as defined in Section 306 of the Act if such source were discharging pollutants.
 - ii. New introductions of pollutants into such works from a source which would be subject to Section 301 of the "Federal Water Quality Act as Amended" if it were discharging such pollutants.
 - iii. A substantial change in volume or character of pollutants being introduced into such works by a source already discharging pollutants into such works at the time the permit is issued.

This notice will include information on the quantity and quality of the wastewater introduced by the new source into the publicly owned treatment works, and on any anticipated impact on the effluent discharged from such works. If this discharge necessitates a revision of the current NPDES permit or pass-through guidelines, discharge by this source is prohibited until the Tennessee Division of Water Resources gives final authorization.

3.3. BIOSOLIDS MANAGEMENT PRACTICES

All sludge and/or biosolids use or disposal must comply with 40 CFR 503 et seq. Biosolids shall be sampled and analyzed at a frequency dependent on the amount used annually.

Any facility that land applies non-exceptional quality biosolids must obtain an appropriate permit from the division in accordance with Chapter 0400-40-15.

- a. Reopener: If an applicable "acceptable management practice" or numerical limitation for pollutants in sewage sludge promulgated under Section 405(d)(2) of the Clean Water Act, as amended by the Water Quality Act of 1987, is more stringent than the sludge pollutant limit or acceptable management practice in this permit, or controls a pollutant not limited in this permit, this permit shall be promptly modified or revoked and reissued to conform to the requirements promulgated under Section 405(d)(2). The permittee shall comply with the limitations by no later than the compliance deadline specified in the applicable regulations as required by Section 405(d)(2) of the Clean Water Act.
- b. Notice of change in sludge disposal practice: The permittee shall give prior notice to the director of any change planned in the permittee's sludge disposal practice. If land application activities are suspended permanently and sludge disposal moves to a municipal solid waste landfill, the permittee shall contact the local Division of Solid Waste Management office address for other permitting and approvals (see table below):

Division of Solid Waste Management			
Office	Location	Zip Code	Phone No.
Cookeville	1221 South Willow Avenue	38506	(931) 432-4015

3.4. PLACEMENT OF SIGNS

Within sixty (60) days of the effective date of this permit, the permittee shall place and maintain a sign(s) at each outfall and any bypass/overflow point in the collection system. For the purposes of this requirement, any bypass/overflow point that has discharged five (5) or more times in the last year must be so posted. The sign(s) should be clearly visible to the public from the bank and the receiving stream. The minimum sign size should be two feet by two feet (2' x 2') with one-inch (1") letters. The sign should be made of durable material and have a white background with black letters.

The sign(s) are to provide notice to the public as to the nature of the discharge and, in the case of the permitted outfalls, that the discharge is regulated by the Tennessee Department of Environment and Conservation, Division of Water Resources. The following is given as an example of the minimal amount of information that must be included on the sign:

Permitted CSO or unpermitted bypass/overflow point:

**UNTREATED WASTEWATER DISCHARGE POINT
Baxter STP**

**(931) 858-4111
NPDES Permit NO. TN0021121
TENNESSEE DIVISION OF WATER RESOURCES
1-888-891-8332 ENVIRONMENTAL FIELD OFFICE - Cookeville**

NPDES Permitted Municipal/Sanitary Outfall:

**TREATED MUNICIPAL/SANITARY WASTEWATER
Baxter STP**

**(931) 858-4111
NPDES Permit NO. TN0021121
TENNESSEE DIVISION OF WATER RESOURCES
1-888-891-8332 ENVIRONMENTAL FIELD OFFICE - Cookeville**

No later than sixty (60) days from the effective date of this permit, the permittee shall have the above sign(s) on display in the location specified.

3.5. ANTIDegradation

Pursuant to the Rules of the Tennessee Department of Environment and Conservation, Chapter 0400-40-03-.06, titled "Tennessee Antidegradation Statement," which prohibits the degradation of exceptional Tennessee waters and the increased discharges of substances that cause or contribute to impairment, the permittee shall further be required, pursuant to the terms and conditions of this permit, to comply with the effluent limitations and schedules of compliance required to implement applicable water quality standards, to comply with a State Water Quality Plan or other state or federal laws or regulations, or where practicable, to comply with a standard permitting no discharge of pollutants.

4.0. DEFINITIONS AND ACRONYMS

4.1. DEFINITIONS

"Biosolids" are treated sewage sludge that have contaminant concentrations less than or equal to the contaminant concentrations listed in Table 1 of subparagraph (3)(b) of Rule 0400-40-15-.02, meet any one of the ten vector attraction reduction options listed in part (4)(b)1, 2, 3, 4, 5, 6, 7, 8, 9, or 10 of Rule 0400-40-15-.04, and meet either one of the six pathogen reduction alternatives for Class A listed in part (3)(a)3, 4, 5, 6, 7, or 8, or one of the three pathogen reduction alternatives for Class B listed in part (3)(b)2, 3, or 4 of Rule 0400-40-15-.04.

A **"bypass"** is defined as the intentional diversion of waste streams from any portion of a treatment facility.

A **"calendar day"** is defined as the 24-hour period from midnight to midnight or any other 24-hour period that reasonably approximates the midnight to midnight time period.

A **"composite sample"** is a combination of not less than 8 influent or effluent portions, of at least 100 ml, collected over a 24-hour period. Under certain circumstances a lesser time period may be allowed, but in no case, less than 8 hours.

The **"daily maximum concentration"** is a limitation on the average concentration in units of mass per volume (e.g. milligrams per liter), of the discharge during any calendar day. When a proportional-to-flow composite sampling device is used, the daily concentration is the concentration of that 24-hour composite; when other sampling means are used, the daily concentration is the arithmetic mean of the concentrations of equal volume samples collected during any calendar day or sampling period.

"Discharge" or "discharge of a pollutant" refers to the addition of pollutants to waters from a source.

A **"dry weather overflow"** is a type of sanitary sewer overflow and is defined as one day or any portion of a day in which unpermitted discharge of wastewater from the collection or treatment system other than through the permitted outfall occurs and is not directly related to a rainfall event. Discharges from more than one point within a 24-hour period shall be counted as separate overflows.

"Degradation" means the alteration of the properties of waters by the addition of pollutants, withdrawal of water, or removal of habitat, except those alterations of a short duration.

"De Minimis" - Degradation of a small magnitude, as provided in this paragraph.

(a) Discharges and withdrawals

1. Subject to the limitation in part 3 of this subparagraph, a single discharge other than those from new domestic wastewater sources will be considered de minimis if it uses

less than five percent of the available assimilative capacity for the substance being discharged.

2. Subject to the limitation in part 3 of this subparagraph, a single water withdrawal will be considered de minimis if it removes less than five percent of the 7Q10 flow of the stream.

3. If more than one activity described in part 1 or 2 of this subparagraph has been authorized in a segment and the total of the authorized and proposed impacts uses no more than 10% of the assimilative capacity, or 7Q10 low flow, they are presumed to be de minimis. Where the total of the authorized and proposed impacts uses 10% of the assimilative capacity, or 7Q10 low flow, additional degradation may only be treated as de minimis if the Division finds on a scientific basis that the additional degradation has an insignificant effect on the resource.

(b) Habitat alterations authorized by an Aquatic Resource Alteration Permit (ARAP) are de minimis if the Division finds that the impacts, individually and cumulatively are offset by impact minimization and/or in-system mitigation, provided however, in ONRWs the mitigation must occur within the ONRW.

An "**ecoregion**" is a relatively homogeneous area defined by similarity of climate, landform, soil, potential natural vegetation, hydrology, or other ecologically relevant variables.

The "**geometric mean**" of any set of values is the n^{th} root of the product of the individual values where "n" is equal to the number of individual values. The geometric mean is equivalent to the antilog of the arithmetic mean of the logarithms of the individual values. For the purposes of calculating the geometric mean, values of zero (0) shall be considered to be one (1).

A "**grab sample**" is a single influent or effluent sample collected at a particular time.

The "**instantaneous maximum concentration**" is a limitation on the concentration, in milligrams per liter, of any pollutant contained in the wastewater discharge determined from a grab sample taken from the discharge at any point in time.

The "**instantaneous minimum concentration**" is the minimum allowable concentration, in milligrams per liter, of a pollutant parameter contained in the wastewater discharge determined from a grab sample taken from the discharge at any point in time.

The "**monthly average amount**", shall be determined by the summation of all the measured daily discharges by weight divided by the number of days during the calendar month when the measurements were made.

The "**monthly average concentration**", other than for *E. coli* bacteria, is the arithmetic mean of all the composite or grab samples collected in a one-calendar month period.

A "**one week period**" (or "**calendar-week**") is defined as the period from Sunday through Saturday. For reporting purposes, a calendar week that contains a change of month shall be considered part of the latter month.

"**Pollutant**" means sewage, industrial wastes, or other wastes.

A "**quarter**" is defined as any one of the following three-month periods: January 1 through March 31, April 1 through June 30, July 1 through September 30, and/or October 1 through December 31.

A "**rainfall event**" is defined as any occurrence of rain, preceded by 10 hours without precipitation that results in an accumulation of 0.01 inches or more. Instances of rainfall occurring within 10 hours of each other will be considered a single rainfall event.

A "**rationale**" (or "fact sheet") is a document that is prepared when drafting an NPDES permit or permit action. It provides the technical, regulatory and administrative basis for an agency's permit decision.

A "**reference site**" means least impacted waters within an ecoregion that have been monitored to establish a baseline to which alterations of other waters can be compared.

A "**reference condition**" is a parameter-specific set of data from regional reference sites that establish the statistical range of values for that particular substance at least-impacted streams.

A "**sanitary sewer overflow (SSO)**" is defined as an unpermitted discharge of wastewater from the collection or treatment system other than through the permitted outfall.

"**Sewage**" means water-carried waste or discharges from human beings or animals, from residences, public or private buildings, or industrial establishments, or boats, together with such other wastes and ground, surface, storm, or other water as may be present.

"**Severe property damage**" when used to consider the allowance of a bypass or SSO means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass or SSO. Severe property damage does not mean economic loss caused by delays in production.

"**Sewerage system**" means the conduits, sewers, and all devices and appurtenances by means of which sewage and other waste is collected, pumped, treated, or disposed.

"**Sludge**" or "**sewage sludge**" is solid, semi-solid, or liquid residue generated during the treatment of domestic sewage in a treatment works. Sewage sludge includes, but is not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment processes; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the firing of sewage sludge in a sewage sludge incinerator or grit and screenings generated during preliminary treatment of domestic sewage in a treatment works.

A "**subecoregion**" is a smaller, more homogenous area that has been delineated within an ecoregion.

"**Upset**" means an exceptional incident in which there is unintentional and temporary noncompliance with technology-based effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent

caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.

The term, "**washout**" is applicable to activated sludge plants and is defined as loss of mixed liquor suspended solids (MLSS) of 30.00% or more from the aeration basin(s).

"**Waters**" means any and all water, public or private, on or beneath the surface of the ground, which are contained within, flow through, or border upon Tennessee or any portion thereof except those bodies of water confined to and retained within the limits of private property in single ownership which do not combine or effect a junction with natural surface or underground waters.

The "**weekly average amount**", shall be determined by the summation of all the measured daily discharges by weight divided by the number of days during the calendar week when the measurements were made.

The "**weekly average concentration**", is the arithmetic mean of all the composite samples collected in a one-week period. The permittee must report the highest weekly average in the one-month period.

4.2. ACRONYMS AND ABBREVIATIONS

1Q10 – 1-day minimum, 10-year recurrence interval

30Q20 – 30-day minimum, 20-year recurrence interval

7Q10 – 7-day minimum, 10-year recurrence interval

BAT – best available technology economically achievable

BCT – best conventional pollutant control technology

BDL – below detection level

BOD₅ – five day biochemical oxygen demand

BPT – best practicable control technology currently available

CBOD₅ – five day carbonaceous biochemical oxygen demand

CEI – compliance evaluation inspection

CFR – code of federal regulations

CFS – cubic feet per second

CFU – colony forming units

CIU – categorical industrial user

CSO – combined sewer overflow

DMR – discharge monitoring report

D.O. – dissolved oxygen

E. coli – *Escherichia coli*

EFO – environmental field office

LB(lb) - pound

IC₂₅ – inhibition concentration causing 25% reduction in survival, reproduction and growth of the test organisms

IU – industrial user

IWS – industrial waste survey

LC₅₀ – acute test causing 50% lethality

MDL – method detection level

MGD – million gallons per day

MG/L(mg/l) – milligrams per liter

ML – minimum level of quantification

ml – milliliter

MLSS – mixed liquor suspended solids

MOR – monthly operating report

NODI – no discharge

NPDES – national pollutant discharge elimination system

PL – permit limit

POTW – publicly owned treatment works

RDL – required detection limit

SAR – semi-annual [pretreatment program] report

SIU – significant industrial user

SSO – sanitary sewer overflow

STP – sewage treatment plant

TCA – Tennessee code annotated

TDEC – Tennessee Department of Environment and Conservation

TIE/TRE – toxicity identification evaluation/toxicity reduction evaluation

TMDL – total maximum daily load

TRC – total residual chlorine

TSS – total suspended solids

WQBEL – water quality based effluent limit

RATIONALE

Baxter STP
NPDES Permit No. TN0021121
Date: May 8, 2017
Permit Writer: Jim McAdoo

1. FACILITY INFORMATION

Baxter STP
Honorable John Martin - Mayor
Baxter, Putnam County, Tennessee
(931) 858-4111
Treatment Plant Average Design Flow: .5 MGD
Percentage Industrial Flow: 0 %
Treatment Description: Activated sludge plant with chlorination and dechlorination
Certified Operator Grades: STP: III; CS: I; Date Rated: 03/14/03

2. RECEIVING STREAM INFORMATION

Mine Lick Creek at mile 15
Watershed Group: Caney Fork
Hydrocode: 05130108
Low Flow: 7Q10 = 0.62 MGD (1.0 CFS)
Low Flow Reference:
Stream Assessment Database
Water Quality Designation: Unavailable conditions
Stream Classification Categories:

Domestic Wtr Supply	Industrial	Fish & Aquatic	Recreation
		X	X
Livestock Wtr & Wlife	Irrigation	Navigation	
X	X		

Water Quality Assessment: Partially supporting

3. CURRENT PERMIT STATUS

Permit Type:	Municipal
Classification:	Minor
Issuance Date:	01-AUG-12
Expiration Date:	31-JUL-17
Effective Date:	01-SEP-12

4. **NEW PERMIT LIMITATIONS AND COMPLIANCE SCHEDULE SUMMARY**

Compliance Schedule Summary

Description of Report to be Submitted	Reference Section in Permit
Monthly Discharge Monitoring Reports	1.3.1
Monthly Operational Reports	1.3.4
Monthly Bypass and Overflow Summary Report	1.3.5.1
Industrial Waste Survey Report within 120 days of the effective permit date	3.2.a
Technical review of the need to recalculate local limits within 120 days of the permit effective date	3.2.a
Biomonitoring Report beginning within 90 days of the effective permit date	3.4

For comparison, this rationale contains a table depicting the previous permit limits and effluent monitoring requirements in Appendix 1.

5. **PREVIOUS PERMIT DISCHARGE MONITORING REPORT REVIEW**

A review of the DMR summary from September 2012 to January 2017 reveals that the City of Baxter has exceeded permit limits for Nitrogen, total (as N) annual average, 15.3 pounds per day, twice (April 2013 and January 2016) and the pH daily minimum, 6.5 STU, once (November 2015).

A complete discharge monitoring report summary is located in Appendix 2.

The permittee requested in the renewal permit application packet reduction of the monitoring frequency from three times per week to once per week for CBOD₅, Total Suspended Solids, Settleable Solids, Nitrogen-Ammonia Total (as N) and E. coli.

EPA allows for reduction in monitoring frequencies per the guidance document, "Interim Guidance for Performance-Based Reduction of NPDES Permit Monitoring Frequencies, April 1996". Reductions in the monitoring frequency are allowed in situations where facilities are discharging in compliance with their permit terms and conditions. The reductions in frequency are a function of both the significance of non-compliance and the level that the long term average effluent concentrations are below the permit limits. Non-compliance greater than or equal to 1.2 times the limit is considered significant for conventional pollutants (CBOD₅, and TSS), and 1.4 times the permit limits considered significant for non-conventional pollutants (ammonia and settleable solids).

The division considers monitoring frequency reductions for parameters that serve as indicators of the treatment process performance such as CBOD₅ and TSS even if the limits are water-quality based. It does not consider such reductions for parameters

whose limits are imperative for protecting the fishable and swimmable uses of the stream. For the two-year reporting period reviewed, there were no effluent violations for CBOD₅, TSS, ammonia and settleable solids. Additionally, the long term average of the effluent concentrations of these parameters were all less than 25% of the permit limit. Therefore, monitoring frequencies for CBOD₅, TSS, ammonia, and settleable solids are being reduced to once per week. The data and analysis are shown in Appendix 3. More frequent sampling to demonstrate compliance with effluent limitations are at the discretion of the permittee.

We concur to reduce the monitoring frequency for the requested parameters except E. coli. Refer to Section 6.5 for an explanation about E. coli.

Revision of the minimum pH to 6.0 S.U. is consistence with current water quality standards rule 0400-40-03.

6. PROPOSED EFFLUENT LIMITS AND RATIONALE

6.1. CBOD₅, DISSOLVED OXYGEN, AND PERCENT REMOVALS REQUIREMENTS

- a. Streeter-Phelps modeling was performed during a previous issuance of this permit at various conditions to determine allowable organic loadings. The monthly average limits for CBOD₅ (20.0 mg/l), NH₃-N (2.0 mg/l), and D.O. (6.0 mg/l) still apply and are considered sufficient to result in an instream dissolved oxygen concentration that remains above the required minimum of 5.0 mg/l. Modeling results are located in the permit file administrative record.

In addition to CBOD₅, NH₃-N undergoes biological oxidation in a receiving stream thereby utilizing in stream oxygen and potentially reducing oxygen levels below water quality standards. Ammonia as N is also a pollutant that exhibits toxicity to fish and other aquatic life. The two affects are analyzed separately and the division imposes the most stringent limit in the permit.

- b. The treatment facility is required to remove 85% of the CBOD₅ and TSS that enter the facility on a monthly basis. This is part of the minimum requirement for all municipal treatment facilities contained in Code of Federal Regulations 40 Part 133.102. The reasons stated by the U.S.E.P.A. for these requirements are to achieve these two basic objectives:

- (1) To encourage municipalities to correct excessive inflow and infiltration (I/I) problems in their sanitary sewer systems, and
- (2) To help prevent intentional dilution of the influent wastewater as a means of meeting permit limits.

The treatment facility is required to remove 40% of the CBOD₅ and TSS that enter the facility on a daily basis. This percent removal will be calculated three times per week and recorded on the Monthly Operation Report. The number of excursions (days when CBOD₅ and/or TSS removal is less than 40%) will be reported on the Discharge Monitoring Report.

6.2. NH₃-N TOXICITY

To access toxicity impacts, the state utilizes the EPA document, 1999 Update to Ambient Water Quality Criteria for Ammonia, pursuant to 0400-40-03-.0-3(3)(j), and assumed stream temperatures of 25°C and 15°C and pH of 8.0 to derive an allowable instream protection value protective of chronic exposure to a continuous discharge. A mass balance equation with sewage treatment facility and stream flows and this allowable value determines the monthly average permit limit. The criteria document states that a 30Q5 flow value is protective in deriving allowable values. Where the division has 30Q5 flow values, the division may use them. Otherwise, the division utilizes the available 7Q10 or 1Q10 values that are generally more conservative. The criteria continuous concentrations (CCC) derived from assumed temperature and pH values are as follows:

CCC values based on temperature and pH, in mg/L:

Temperature (°C)	7.5 pH	8.0 pH	Temperature (°C)	7.5 pH	8.0 pH
25	2.22	1.24	15	4.22	2.36

The mass balance equation is as follows:

$$CCC = \frac{Q_S C_S + Q_{STP} C_{STP}}{Q_S + Q_{STP}} \quad \text{or,} \quad C_{STP} = \frac{CCC(Q_S + Q_{STP}) - (Q_S C_S)}{Q_{STP}}$$

where:

CCC = Criteria continuous concentration (mg/l)
Q_S = 7Q10 flow of receiving stream (0.62 MGD)
Q_{STP} = Design flow of STP (0.5 MGD)
C_S = Assumed/Measured instream NH₃ (mg/l)
C_{STP} = Allowable STP discharge of NH₃ (mg/l)

$$C_{STP} = \frac{1.24 (0.62 \text{ MGD} + 0.5 \text{ MGD}) - (0.62 \text{ MGD} \times 0.1 \text{ mg/l})}{.5 \text{ MGD}} = 2.65 \text{ mg/l (summer)}$$

$$C_{STP} = \frac{2.36 (0.62 \text{ MGD} + 0.5 \text{ MGD}) - (0.62 \text{ MGD} \times 0.1 \text{ mg/l})}{.5 \text{ MGD}} = 5.16 \text{ mg/l (winter)}$$

The monthly average limits for NH₃-N (1.0 mg/l-summer, 2.0 mg/l-winter) will be retained from the previous permit due to the antidegradation provision of 40 CFR 122.44(l) that requires a reissued permit to be as stringent as the previous permit.

6.3. CHLORINATION

The residual chlorine limit is derived using the mass balance formula and the EPA instream protection value of 0.019 mg/l for fish and aquatic life. Applying this formula yields the following calculation:

$$\frac{0.019 (Q_d + Q_s)}{Q_d} = \text{Limit (mg/l)} = \frac{0.019(0.5 + 0.62)}{0.5} = 0.042 \text{ mg/l} \approx 0.04 \text{ mg/l}$$

where:

0.019	=	instream protection value (acute)
0.5	=	Q _d , design flow of STP (MGD)
0.62	=	Q _s , 7Q ₁₀ flow of receiving stream (MGD)

The total residual chlorine limit is retained from the previous permit due to the antibacksliding provision of 40 CFR 122.44(l) that requires a reissued permit to be as stringent as the previous permit.

6.4. TOTAL NITROGEN AND TOTAL PHOSPHOROUS MONITORING/REPORTING

The Annual Average load limits proposed in this permit, Nitrogen, total (as N) 15.3 pounds per day and phosphorus, total (as P) of 4.9 pounds per day are for anti-degradation purposes only and are based on values supplied by the permittee. The proposed limits do not constitute technology-based limits. Nor do they represent water-quality based numeric criteria. These loading limits can potentially be altered to the extent allowed by law via waste load allocations established in Total Maximum Daily Loads (TMDLs) or overall nutrient reduction strategy which would constitute new information in accordance with 40 CFR 122.44(l)(2)(B)(1).

Because the limits are applied for anti-degradation purposes, the division is limiting load (versus concentration and load) since the load calculation gives credit for flows diverted for reuse or land application. The limits are applied as annual loads for a couple of reasons. Annual limits offer flexibility for achieving permit compliance for pollutants the facility was not specifically designed to remove and whose removal is a function of numerous variables including seasonal variables.

6.5. *E. COLI* REQUIREMENTS

Disinfection of wastewater is required to protect the receiving stream from pathogenic microorganisms. Fecal coliform and *E. coli* are indicator organisms used as a measure of bacteriological health of a receiving stream and the effectiveness of disinfection.

As of September 30, 2004, the criterion for fecal coliform has been removed from the State's Water Quality Standards. Thus, the division imposes an *E. coli* limit on discharges of treated sewage for the protection of recreational use of the stream in lieu of the fecal coliform limit. The *E. coli* daily maximum limit of 487 colonies per 100

ml applies to lakes and exceptional Tennessee waters. A maximum daily limit of 941 colonies per 100 ml applies to all other recreational waters.

The permittee requested that the E. coli monitoring frequency also be reduced from three times per week to once per week. It is the division's opinion that it is in the best interest of permittee and the state to retain the monitoring frequency at three times per week to protect recreational use of the receiving stream.

6.6. OVERFLOW AND BYPASS REPORTING

For the purposes of demonstrating proper operation of the collection, transmission, and treatment system, the permit defines overflow as any release of sewage other than through permitted outfalls. This definition includes, but is not necessarily limited to, sanitary sewer overflows and dry weather overflows as defined. For example, a collection system blockage or hydraulic overload that causes backup and release of sewage into a building during a wet weather event may not clearly fit either the definition of a sanitary sewer overflow or a dry weather overflow. Still, any unpermitted release potentially warrants permittee mitigation of human health and/or water quality impacts via direct or indirect contact and demonstrates a hydraulic problem in the system that warrants permittee consideration as part of proper operation and maintenance of the system.

However, for the more typical, unpermitted, releases into the environment, this permit intends interchangeable use of the terms, "overflow" and "sanitary sewer overflow" for compliance reporting purposes.

7. OTHER PERMIT REQUIREMENTS AND CONDITIONS

7.1. CERTIFIED WASTEWATER TREATMENT OPERATOR

The waste treatment facilities shall be operated under the supervision of a Grade III certified wastewater treatment operator in accordance with the Water Environmental Health Act of 1984. Operator grades are under jurisdiction of the Water and Wastewater Operators Certification Board. This NPDES permit is under jurisdiction of the Tennessee Board of Water Quality, Oil and Gas. Operator grades are rated and recommended by the Division of Water Resources pursuant to Rule 0400-49-01 (formerly 1200-05-03) and are included in this fact sheet for reference. The grades are intentionally not specified in the permit so that the operation certification board can authorize changes in grade without conflicting with this permit.

7.2. COLLECTION SYSTEM CERTIFIED OPERATOR

The collection system shall be operated under the supervision of a Grade I certified collection system operator in accordance with the Water Environmental Health Act of 1984.

7.3. PRETREATMENT PROGRAM

The Baxter STP has received an exemption from development of a pretreatment program due to the lack of any significant industrial users. To keep the exemption, the City of Baxter must complete an updated Industrial Waste Survey within 120 days of the effective date of the permit, unless such a survey has been submitted within 3 years of the effective date. The City of Baxter must notify the division immediately of its intent to connect a significant industrial user to the sewage system.

7.4. PERMIT TERM

This permit is being reissued for 5 years in order to coordinate its reissuance with other permits located within the Caney Fork Watershed.

7.6. ELECTRONIC REPORTING

Starting on December 21, 2016, all Individual NPDES Permit holders will be required to submit Discharge Monitoring Reports (DMRs) electronically through NetDMR. Prior to 21 December 2016, the permittee may elect to electronically submit DMRs instead of mailing paper DMRs.

EPA published the National Pollutant Discharge Elimination System (NPDES) Electronic Reporting Rule, which will modernize Clean Water Act reporting for municipalities, industries and other facilities. The rule was published in the Federal Register on October 22, 2015 and became effective on December 22, 2015. The rule replaces most paper-based NPDES reporting requirements with electronic reporting.

More information is available at: <http://www.tn.gov/environment/article/wr-netdmr-electronic-reporting>:

- Getting Started on NetDMR,
- Electronic reporting schedule,
- Training Opportunities,
- NetDMR User Guide and other supporting information.

8. ANTIDEGRADATION STATEMENT/WATER QUALITY STATUS

Tennessee's Antidegradation Statement is found in the Rules of the Tennessee Department of Environment and Conservation, Chapter 0400-40-03-.06. It is the purpose of Tennessee's standards to fully protect existing uses of all surface waters as established under the Act.

Stream determinations for this permit action are associated with the waterbody segment identified by the division as segment ID# TN05130108097_2000.

The division has made a water quality assessment of the receiving waters associated with the subject discharge(s) and has found the receiving stream to be neither an exceptional nor outstanding national resource water. The division

assesses this water as not supporting its designated Fish and Aquatic Life use due to nutrients. This permit continues to impose the limits established in the previous permit. At the design flow rate 0.5 MGD these loads are approximate to treatment levels of 5 mg/L TN and 1.0 mg/L TP. These levels represent treatment levels recommended in the state wide nutrient reduction framework.

TMDLs have been developed and approved for this waterbody segment on the following parameters and dates:

<u>Parameter</u>	<u>TMDL Approval Date</u>
E. Coli	January 12, 2017

The proposed terms and conditions of this permit comply with the waste load allocations of these TMDLs.

APPENDIX 1 PREVIOUS PERMIT LIMITS

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : All Year						
Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C	<=	125	lb/d	Composite	Three Per Week	Weekly Average
CBOD, 5-day, 20 C	<=	35	mg/L	Composite	Three Per Week	Daily Maximum
CBOD, 5-day, 20 C	<=	20	mg/L	Composite	Three Per Week	Monthly Average
CBOD, 5-day, 20 C	<=	30	mg/L	Composite	Three Per Week	Weekly Average
CBOD, 5-day, 20 C	<=	83	lb/d	Composite	Three Per Week	Monthly Average
Chlorine, total residual (TRC)	<=	.02	mg/L	Grab	Five Per Week	Instantaneous Maximum
E. coli, MTEC-MF	<=	941	#/100mL	Grab	Three Per Week	Daily Maximum
E. coli, MTEC-MF	<=	126	#/100mL	Grab	Three Per Week	Monthly Geometric Mean
Flow	Report	-	MGD	Continuous	Daily	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Monthly Average
Nitrogen, Kjeldahl, Total (TKN as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	<=	15.3	lb/d	Calculated	Annual	Annual Average
Oxygen, dissolved (DO)	>=	6	mg/L	Grab	Five Per Week	Instantaneous Minimum
Phosphorus, total (as P)	Report	-	lb/d	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	<=	4.9	lb/d	Calculated	Annual	Annual Average
Settleable Solids	<=	1	mL/L	Composite	Three Per Week	Daily Maximum
Total Suspended Solids (TSS)	<=	167	lb/d	Composite	Three Per Week	Weekly Average
Total Suspended Solids (TSS)	<=	125	lb/d	Composite	Three Per Week	Monthly Average
Total Suspended Solids (TSS)	<=	30	mg/L	Composite	Three Per Week	Monthly Average
Total Suspended Solids (TSS)	<=	45	mg/L	Composite	Three Per Week	Daily Maximum
Total Suspended Solids (TSS)	<=	40	mg/L	Composite	Three Per Week	Weekly Average
pH	>	6.5	SU	Grab	Five Per Week	Minimum
pH	<	9	SU	Grab	Five Per Week	Maximum

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : Summer

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Nitrogen, Ammonia total (as N)	<=	1.5	mg/L	Composite	Three Per Week	Weekly Average
Nitrogen, Ammonia total (as N)	<=	4	lb/d	Composite	Three Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	2	mg/L	Composite	Three Per Week	Daily Maximum
Nitrogen, Ammonia total (as N)	<=	1	mg/L	Composite	Three Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	6	lb/d	Composite	Three Per Week	Weekly Average

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : Winter

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Nitrogen, Ammonia total (as N)	<=	4	mg/L	Composite	Three Per Week	Daily Maximum
Nitrogen, Ammonia total (as N)	<=	2	mg/L	Composite	Three Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	3	mg/L	Composite	Three Per Week	Weekly Average
Nitrogen, Ammonia total (as N)	<=	8	lb/d	Composite	Three Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	13	lb/d	Composite	Three Per Week	Weekly Average

Description : External Outfall, Number : 001, Monitoring : Percent Removal, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C, % removal	>=	40	%	Calculated	Three Per Week	Minimum Percent Removal
CBOD, 5-day, 20 C, % removal	>=	85	%	Calculated	Three Per Week	Average (Minimum)
TSS, % removal	>=	85	%	Calculated	Three Per Week	Average (Minimum)
TSS, % removal	>=	40	%	Calculated	Three Per Week	Minimum Percent Removal

Description : External Outfall, Number : 001, Monitoring : Raw Sewage Influent, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C	Report	-	mg/L	Composite	Three Per Week	Monthly Average
CBOD, 5-day, 20 C	Report	-	mg/L	Composite	Three Per Week	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	Report	-	mg/L	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Total Suspended Solids (TSS)	Report	-	mg/L	Composite	Three Per Week	Monthly Average
Total Suspended Solids (TSS)	Report	-	mg/L	Composite	Three Per Week	Daily Maximum

Description : External Outfall, Number : 001, Monitoring : Wet Weather, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Bypass of Treatment	Report	-	occur/mo	Occurrences	Continuous	Monthly Total
Overflow use, occurrences	Report	-	occur/mo	Occurrences	Continuous	Monthly Total

APPENDIX 2

DISCHARGE MONITORING REPORT SUMMARY

	Overflow	Bypass	Flow				CBOD						
			Influent		Effluent		Monthly				Daily		
	Date	No.	# of Bypass	Monthly Average	Daily Max.	Monthly Average	Daily Max.	Influent Conc.	Effluent Conc.	Percent Removal	Average Amount	Influent Conc.	Effluent Conc.
			MGD	MGD	MGD	MGD	mg/L	mg/L	%	lb/day	mg/L	mg/L	
	September-12	0	1	0.158	0.795	0.137	0.713	200	1	99	2	271	2
	October-12	0	0	0.113	0.187	0.092	0.167	234	2	99	1	314	2
	November-12	0	0	0.105	0.29	0.08	0.238	259	1	99	1	320	2
	December-12	0	0	0.272	0.748	0.232	0.68	165	2	99	3	306	3
	January-13	1	1	0.371	0.81	0.331	0.717	90	2	98	6	171	4
	February-13	0	0	0.236	0.4	0.218	0.371	144	1	99	3	204	2
	March-13	0	0	0.297	0.725	0.284	0.702	94	1	99	2	158	1
	April-13	1	0	0.324	0.971	0.296	0.915	127	1	99	3	177	2
	May-13	0	0	0.247	0.93	0.234	0.882	157	1	99	2	255	2
	June-13	0	0	0.094	0.163	0.088	0.156	237	1	99	0.7	321	1
	July-13	0	1	0.26	0.89	0.249	0.858	160	2	99	4	268	5
	August-13	0	1	0.205	0.784	0.195	0.714	185	1	99	3	303	2
	September-13	0	0	0.099	0.215	0.094	0.205	289	1	99	1	399	2
	October-13	0	0	0.094	0.179	0.09	0.171	298	1	99	1	558	1
	November-13	0	0	0.101	0.376	0.097	0.37	344	2	99	2	560	6
	December-13	0	1	0.298	0.949	0.288	0.913	183	2	99	4	349	4
	January-14	0	0	0.274	0.915	0.262	0.876	119	2	98	5	186	5
	February-14	0	0	0.329	0.936	0.315	0.9	87	2	98	8	119	4
	March-14	0	1	0.242	0.958	0.232	0.912	104	2	98	2	183	2
	April-14	0	0	0.293	0.94	0.282	0.897	125	2	98	5	198	3
	May-14	0	0	0.154	0.486	0.148	0.467	137	2	99	3	234	3
	June-14	0	0	0.109	0.21	0.105	0.202	205	1	99	1	253	2
	July-14	0	1	0.112	0.248	0.109	0.241	199	1	99	1	286	2
	August-14	0	0	0.107	0.308	0.103	0.298	221	1	99	1	299	1
	September-14	0	0	0.129	0.582	0.122	0.554	174	1	99	2	243	3
	October-14	1	1	0.318	1.3	0.297	1.03	121	1	99	3	218	3
	November-14	1	0	0.273	0.84	0.263	0.81	71	1	99	5	116	2
	December-14	0	0	0.374	0.998	0.36	0.97	114	2	98	4	163	4
	January-15	0	0	0.273	0.89	0.263	0.856	99	2	98	3	143	3
	February-15	1	0	0.291	0.791	0.28	0.757	90	2	98	3	150	2
	March-15	0	0	0.379	0.91	0.362	0.861	94	2	98	11	153	8
	April-15	0	0	0.25	0.53	0.239	0.505	136	2	99	4	205	4
	May-15	0	0	0.123	0.301	0.118	0.298	241	2	99	2	409	3
	June-15	0	0	0.193	0.64	0.184	0.618	157	1	99	2	245	2
	July-15	1	0	0.288	1.08	0.277	1.04	169	1	99	2	263	2
	August-15	0	0	0.116	0.26	0.11	0.248	266	1	99	1	305	2.5
	September-15	0	0	0.097	0.241	0.093	0.228	379	0.49	99	0.36	600	1
	October-15	0	0	0.137	0.421	0.132	0.403	273	1	99	1	425	2
	November-15	1	0	0.236	0.98	0.225	0.923	227	1	99	3	346	4
	December-15	0	1	0.407	1.05	0.39	0.998	116	2	98	8	202	6

Total Suspended Solids						Ammonia as N			E.coli		Settleable Solids
Monthly				Daily		Monthly		Daily	Monthly Average Conc.	Daily Max. Conc.	Daily Max. Conc.
Influent Conc.	Effluent Conc.	Percent Removal	Average Amount	Influent Conc.	Effluent Conc.	Average Conc.	Average Amount	Average Conc.			
mg/L	mg/L	%	lb/day	mg/L	mg/L	mg/L	lb/day	mg/L	mg/L	mg/L	mg/L
136	1	99	2	180	2	0.24	0.36	0.29	3	40	0.1
151	1	99	1	194	2	0.18	0.16	0.23	8	112	0.1
142	2	99	1.3	182	3	0.13	0.08	0.22	3	82	0.1
93	3	94	6	160	7	0.13	0.21	0.42	19	236	0.1
66	6	91	20	123	12	0.12	0.34	0.21	15	69	0.1
76	3	96	7	108	5	0.16	0.3	0.29	4	197	0.1
69	3	96	6	95	6	0.2	0.39	0.37	19	143	0.1
93	4	96	8	140	6	0.25	0.48	0.35	10	177	0.1
79	2	97	3	135	4	0.2	0.3	0.23	17	388	0.1
154	2	98	1	205	4	0.32	0.22	0.66	10	132	0.1
101	2	98	5	202	7	0.2	0.33	0.35	16	272	
130	3	98	9	342	14	0.23	0.5	0.48	12	114	
173	1	99	0.79	230	1	0.2	0.15	0.26	7	79	
180	1	99	1	254	3	0.5	0.14	0.26	6	20	
167	5	97	6	214	11	0.28	0.29	0.46	31	272	
84	3	96	7	230	7	0.2	0.43	0.27	28	219	0.1
74	3	96	7	131	7	0.2	0.36	0.6	60	436	
68	4	94	17	146	12	0.14	0.43	0.23	10	328	0.1
78	2	97	4	126	6	0.11	0.17	0.17	9	208	
94	2	98	5	146	4	0.16	0.33	0.2	103	472	
128	2.7	98	6.5	222	13	0.15	0.22	0.24	17	84	
159	1	98	1	220	3	0.19	0.17	0.29	15	249	
142	1	99	1	250	3	0.12	0.1	0.21	22	82	0.1
165	1	99	1	236	2	0.15	0.11	0.24	9	55	0.1
127	3	98	7	180	11	0.16	0.17	0.3	4	43	0.1
109	4	96	14	196	12	0.15	0.36	0.22	42	248	0.1
59	4	93	14	124	9	0.11	0.32	0.14	38	61	0.1
76	4	95	9	120	8	0.14	0.27	0.19	69	172	0.1
63	3	95	6	125	6	0.15	0.3	0.21	51	162.4	0.1
53	3	94	7	89	9	0.1	0.19	0.13	53	272	0.1
69	7	90	32	127	22	0.18	0.75	0.41	41	228	0.1
82	3	96	6	140	6	0.18	0.38	0.24	24	164	0.1
160	1	99	2	232	5	0.31	0.31	0.49	3	58	0.1
103	1	99	2	181	3	0.11	0.15	0.17	6	84	0.1
95	2	98	8	148	6	0.12	0.3	0.17	7	102	0.1
178	2	99	2	292	4	0.16	0.16	0.22	9.7	77	0.1
199	1	99	1	254	2	0.18	0.13	0.24	3	24	0.1
122	2	98	3	204	6	0.13	0.18	0.23	14	81	0.1
96	3	97	10	132	18	0.11	0.2	0.19	5	45	0.1
62	7	89	26	101	12	0.11	0.36	0.19	18	228	0.1

Dissolved Oxygen	pH		Total Nitrogen			Phosphous, Total				
Daily Min. Conc.	Daily Max. Conc.	Daily Min. Conc.	Influent Mo. Avg. Conc.	Effluent Mo. Avg. Conc.	Effluent Annual Avg	Influent Mo. Ave Conc.	Influent Daily Max Conc.	Effluent Mo. Ave Conc.	Effluent Daily Max Conc.	Effluent Annual Avg
mg/L			mg/L	mg/L	lb/day	mg/L	mg/L	mg/L	mg/L	Lb/Day
7.1	7.4	7		2.4	9.2			2.7	2.7	
7.2	7.5	7.1			7.6			2.3	2.3	1.9
8.8	7.4	6.9			4.98			2.4	2.4	1.22
8.7	7.4	7								
9.3	7.5	7.1	20	0.27	5.9	2	2	0.62	0.62	0.99
9.2	7.9	6.9								
9.4	7.4	6.9								
8	7.3	6.8	15	14	35.6	2	2	0.58	0.58	1.3
7.7	7.1	6.8								
7.1	7	6.9								
7	7.1	6.8			11.3					1.5
7.1	7	6.8	87	0.53	5.7	5.1	5.1	2.8	2.8	2
6.7	7	6.7								
7.4	7	6.8	49		8	7.4	7.4	3.2	3.2	2.1
8.1	7	6.6								
9	7.3	6.6								
9.7	7.4	6.7								
9.4	7.2	7	42	0.21	3.5	4.9	4.9	0.42	0.42	0.354
9.4	7.3	7								
8.1	7.4	7	19		4.9	2.4	2.4	1.1	1.1	1.8
7.5	7.3	7.1								
7	7.3	7.1								
7	7.4	7			5.5					1.6
6.9	7.3	6.9	43		6.7	5	5	1.9	1.9	1.5
7.1	7.5	7.1								
7.4	7.2	7								
8	7.5	7.3	27		6.2	3	3	1.2	1.2	1.1
8.7	7.6	7.3								
8.7	7.6	7.1	19		10.9	1.9	1.9	0.94	0.94	1.65
9.1	7.7	7								
8.1	7.6	7								
8.2	7.6	6.9	16	0.48	7.2	3.2		1.7	1.7	2
7.5	7.2	6.9								
7.1	7.4	7.1	20		2.9	2.3	2.3	1.4	1.4	1.6
7	7.4	7			6.8					1.6
7.1	7.1	7	58.9		11	8.5	8.5	4.95		4
7.1	7	6.9								
7.5	7.2	7	27.5		5.08	4.1	4.1	2.46	2.46	2.6
8	7.2	7.1								
8.5	7.3	7								

Date	No.	# of Bypass	Flow				CBOD					
			Influent		Effluent		Monthly				Daily	
			Monthly Average	Daily Max.	Monthly Average	Daily Max.	Influent Conc.	Effluent Conc.	Percent Removal	Average Amount	Influent Conc.	Effluent Conc.
			MGD	MGD	MGD	MGD	mg/L	mg/L	%	lb/day	mg/L	mg/L
January-16	0	0	0.256	0.81	0.246	0.777	119	2	98	4	160	4
February-16	1	1	0.387	1.14	0.372	1.09	62	3	95	12	108	6
March-16	0	0	0.227	0.43	0.219	0.416	110	2	98	3	156	3
April-16												
May-16	0	0	0.098	0.133	0.072	0.1	405	1	99	1	538	2
June-16	0	0	0.139	0.518	0.13	0.5	303	1	99	1	454	3
July-16	0	0	0.236	0.886	0.222	0.84	175	1	99	1	256	1
August-16	0	0	0.106	0.253	0.1	0.24	382	1	99	1	546	1
September-16	0	0	0.103	0.509	0.098	0.48	528	1	99	1	715	2
October-16	0	0	0.081	0.118	0.076	0.113	611	1	99	1	960	1
November-16	0	2	0.09	0.323	0.09	0.343	442	1	99	1	757	3
December-16	0	0	0.364	0.868	0.348	0.835	116	3	97	11	219	13
January-17	0	1	0.417	1	0.407	0.995	100	3	97	11	191	7
Minimum	0.00		0.08	0.12	0.07	0.10	62.00	0.49	95.00	0.36	108.00	1.00
Maximum	1.00		0.42	1.30	0.41	1.09	611.00	3.00	99.00	12.00	960.00	13.00
Average			0.22	0.64	0.20	0.60	200.83	1.49	98.62	3.21	306.50	3.09
Permit Limit	--	--	--	--	--	--	--	20	85	83	--	35
Count	51	51	52	52	52	52	52	52	52	52	52	52
Exceedance								0	0	0		0

Date	Total Suspended Solids						Ammonia as N			E.coli		Settleable Solids
	Monthly				Daily		Monthly		Daily	Monthly Average Conc.	Daily Max. Conc.	Daily Max. Conc.
	Influent Conc.	Effluent Conc.	Percent Removal	Average Amount	Influent Conc.	Effluent Conc.	Average Conc.	Average Amount	Average Conc.			
	mg/L	mg/L	%	lb/day	mg/L	mg/L	mg/L	lb/day	mg/L	mg/L	mg/L	mg/L
January-16	86	5	94	10	128	17	0.13	0.2	0.21	15	104	0.1
February-16	56	7	88	39	102	20	0.11	0.43	0.16	22	210	0.1
March-16	84	2	98	5	106	8	0.17	0.35	0.25	20	89	0.1
April-16												
May-16	206	2	99	1	282	4	0.26	0.16	0.38	5	93	0.1
June-16	190	1.4	99	2	232	4	0.22	0.21	0.32	24	173	0.1
July-16	115	2	98	8	178	10	0.11	0.21	0.14	16	186	
August-16	176	1	99	1	258	3	0.23	0.19	0.36	4	14	
September-16	205	2	99	1	278	3	0.16	0.11	0.22	5	45	
October-16	355	2	99	1	1427	4	0.14	0.09	0.4	2	74	
November-16	324	3	99	4	666	8	0.22	0.24	0.47	5	116	
December-16	99	6	94	18	182	12	0.08	0.24	0.14	33	272	
January-17	125	6	95	23	278	12	0.17	0.6	0.29	47	241	
Minimum	53.00	1.00	88.00	0.79	89.00	1.00	0.08	0.08	0.13	2.00	14.00	0.10
Maximum	355.00	7.00	99.00	39.00	1427.00	22.00	0.50	0.75	0.66	103.00	472.00	0.10
Average	124.54	2.85	96.67	7.47	216.02	7.46	0.18	0.27	0.28	19.98	156.39	0.10
Permit Limit	--	30	85	125	--	45	8	2	4	126	941	1
Count	52	52	52	52	52	52	52	52	52	52	52	35
Exceedance		0	0	0		0	0	0	0	0	0	0

	Dissolved Oxygen	pH		Total Nitrogen			Phosphous, Total				
Date	Daily Min. Conc.	Daily Max. Conc.	Daily Min. Conc.	Influent Mo. Avg. Conc.	Effluent Mo. Avg. Conc.	Effluent Annual Avg	Influent Mo. Ave Conc.	Influent Daily Max Conc.	Effluent Mo. Ave Conc.	Effluent Daily Max Conc.	Effluent Annual Avg
	mg/L			mg/L	mg/L	lb/day	mg/L	mg/L	mg/L	mg/L	Lb/Day
January-16	10.1	7.2	7	30	0.25	16.7	3.19	3.19	1.52	1.52	1.9
February-16	9.5	7.3	6.9								
March-16	9.1	7.3	7								
April-16											
May-16	8.6	7.1	7								
June-16	7.9	7.3	6.9								
July-16	7.7	7.2	6.9			14.8					2.4
August-16	7.6	7.2	7								
September-16	7.7	7.3	6.7	34	0.272	2.6	4.4	4.4	2.7	2.7	1.5
October-16	8.2	7.1	6.6	55.68	0.71	1.77	8.32	8.32	2.51	2.51	1.42
November-16	8	7.3	6.2								
December-16	9	7.6	7.1								
January-17	9.5	7.7	7								
Minimum	6.70	7.00	6.20	15.00	0.21	1.77	1.90	1.90	0.42	0.42	0.35
Maximum	10.10	7.90	7.30	87.00	14.00	35.60	8.50	8.50	4.95	3.20	4.00
Average	8.09	7.32	6.93	35.19	2.12	8.47	4.23	4.30	1.97	1.80	1.73
Permit Limit	6.00	9.00	6.50	--	--	15.3	--	--	--	--	4.90
Count	52	52	52	16	9	23	16	15	19	18	22
Exceedance	0	0	1			2					0

APPENDIX 3

MONITORING REDUCTION FREQUENCY

	Non-conventional pollutants				
	% Removal	TSS	% Removal	Ammonia	Settleable Solids
Effluent limits	85	45	85	4	1
SNC	60.7	63	60.7	4.8	1.2
Date					
April-14	98	4	98	0.2	
May-14	99	13	98	0.24	
June-14	99	3	98	0.29	
July-14	99	3	99	0.21	0.1
August-14	99	2	99	0.24	0.1
September-14	99	11	98	0.3	0.1
October-14	99	12	96	0.22	0.1
November-14	99	9	93	0.14	0.1
December-14	98	8	95	0.19	0.1
January-15	98	6	95	0.21	0.1
February-15	98	9	94	0.13	0.1
March-15	98	22	90	0.41	0.1
April-15	99	6	96	0.24	0.1
May-15	99	5	99	0.49	0.1
June-15	99	3	99	0.17	0.1
July-15	99	6	98	0.17	0.1
August-15	99	4	99	0.22	0.1
September-15	99	2	99	0.24	0.1
October-15	99	6	98	0.23	0.1
November-15	99	18	97	0.19	0.1
December-15	98	12	89	0.19	0.1
January-16	98	17	94	0.21	0.1
February-16	95	20	88	0.16	0.1
March-16	98	8	98	0.25	0.1
Total	24.0	24.0	24.0	24.0	21.0
Average	98.5	8.7	96.1	0.2	0.1
Std dev	0.9	5.8	3.3	0.1	0.00
C.V.	0.01	0.7	0.03	0.3	0.00
% Limit	10.0	19.4	25.8	5.8	10.0
DO, pH, Cl ₂ , and e. coli are not considered for a reduction in monitoring frequencies since the monitoring is imperative to protect Tennessee's fish and aquatic life and human health. Reductions for parameters that serve primarily as operational indicators of the treatment facility are considered.					

APPENDIX 4

EFFLUENT LIMITS AND MONITORING REQUIREMENTS

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C	<=	125	lb/d	Composite	Once Per Week	Weekly Average
CBOD, 5-day, 20 C	<=	35	mg/L	Composite	Once Per Week	Daily Maximum
CBOD, 5-day, 20 C	<=	20	mg/L	Composite	Once Per Week	Monthly Average
CBOD, 5-day, 20 C	<=	30	mg/L	Composite	Once Per Week	Weekly Average
CBOD, 5-day, 20 C	<=	83	lb/d	Composite	Once Per Week	Monthly Average
Chlorine, total residual (TRC)	<=	.02	mg/L	Grab	Five Per Week	Instantaneous Maximum
E. coli, MTEC-MF	<=	941	#/100mL	Grab	Three Per Week	Daily Maximum
E. coli, MTEC-MF	<=	126	#/100mL	Grab	Three Per Week	Monthly Geometric Mean
Flow	Report	-	MGD	Continuous	Daily	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Monthly Average
Nitrogen, Kjeldahl, Total (TKN as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	<=	15.3	lb/d	Calculated	Annual	Annual Average
Oxygen, dissolved (DO)	>=	6	mg/L	Grab	Five Per Week	Instantaneous Minimum
Phosphorus, total (as P)	Report	-	lb/d	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	<=	4.9	lb/d	Calculated	Annual	Annual Average
Settleable Solids	<=	1	mL/L	Composite	Once Per Week	Daily Maximum
Total Suspended Solids (TSS)	<=	167	lb/d	Composite	Once Per Week	Weekly Average
Total Suspended Solids (TSS)	<=	125	lb/d	Composite	Once Per Week	Monthly Average
Total Suspended Solids (TSS)	<=	30	mg/L	Composite	Once Per Week	Monthly Average
Total Suspended Solids (TSS)	<=	45	mg/L	Composite	Once Per Week	Daily Maximum
Total Suspended Solids (TSS)	<=	40	mg/L	Composite	Once Per Week	Weekly Average
pH	>	6.0	SU	Grab	Five Per Week	Minimum
pH	<	9.0	SU	Grab	Five Per Week	Maximum

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : Summer

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Nitrogen, Ammonia total (as N)	<=	1.5	mg/L	Composite	Once Per Week	Weekly Average
Nitrogen, Ammonia total (as N)	<=	4	lb/d	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	2	mg/L	Composite	Once Per Week	Daily Maximum
Nitrogen, Ammonia total (as N)	<=	1	mg/L	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	6	lb/d	Composite	Once Per Week	Weekly Average

Description : External Outfall, Number : 001, Monitoring : Effluent Gross, Season : Winter

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Nitrogen, Ammonia total (as N)	<=	4	mg/L	Composite	Once Per Week	Daily Maximum
Nitrogen, Ammonia total (as N)	<=	2	mg/L	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	3	mg/L	Composite	Once Per Week	Weekly Average
Nitrogen, Ammonia total (as N)	<=	8	lb/d	Composite	Once Per Week	Monthly Average
Nitrogen, Ammonia total (as N)	<=	13	lb/d	Composite	Once Per Week	Weekly Average

Description : External Outfall, Number : 001, Monitoring : Percent Removal, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C, % removal	>=	40	%	Calculated	Three Per Week	Minimum Percent Removal
CBOD, 5-day, 20 C, % removal	>=	85	%	Calculated	Three Per Week	Average (Minimum)
TSS, % removal	>=	85	%	Calculated	Three Per Week	Average (Minimum)
TSS, % removal	>=	40	%	Calculated	Three Per Week	Minimum Percent Removal

Description : External Outfall, Number : 001, Monitoring : Raw Sewage Influent, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
CBOD, 5-day, 20 C	Report	-	mg/L	Composite	Once Per Week	Monthly Average
CBOD, 5-day, 20 C	Report	-	mg/L	Composite	Once Per Week	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Daily Maximum
Flow	Report	-	MGD	Continuous	Daily	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Nitrogen, total (as N)	Report	-	mg/L	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	Report	-	mg/L	Composite	Quarterly	Daily Maximum
Phosphorus, total (as P)	Report	-	mg/L	Composite	Quarterly	Monthly Average
Total Suspended Solids (TSS)	Report	-	mg/L	Composite	Once Per Week	Monthly Average
Total Suspended Solids (TSS)	Report	-	mg/L	Composite	Once Per Week	Daily Maximum

Description : External Outfall, Number : 001, Monitoring : Wet Weather, Season : All Year

Parameter	Qualifier	Value	Unit	Sample Type	Frequency	Statistical Base
Bypass of Treatment	Report	-	occur/mo	Occurrences	Continuous	Monthly Total
Overflow use, occurrences	Report	-	occur/mo	Occurrences	Continuous	Monthly Total